



KENYA ELECTRICITY GENERATING COMPANY PLC

TENDER No. KGN-HYD-013-2019

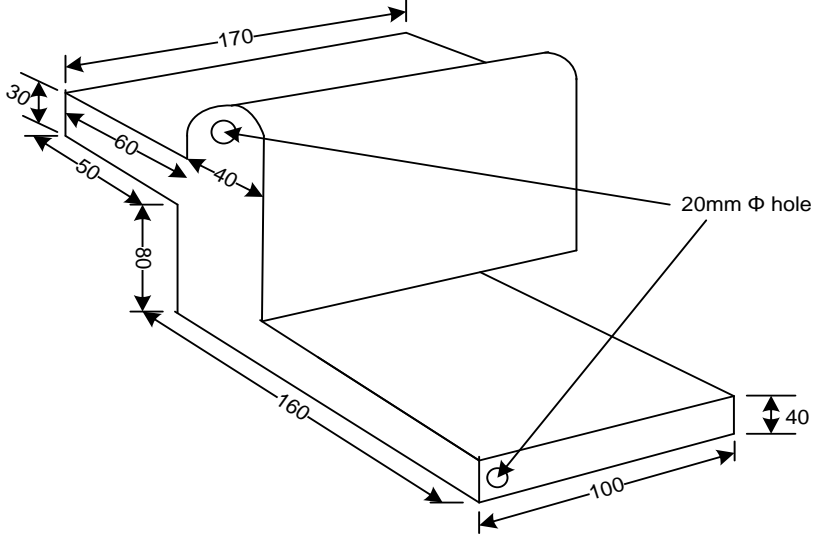
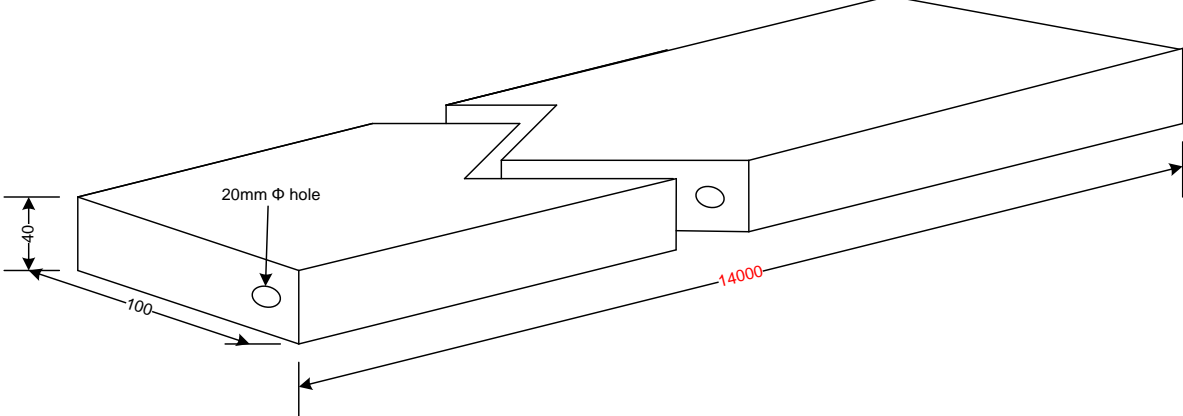
TENDER FOR SUPPLY INTAKE AND SPILLGATE SEALS FOR KAMBURU, KINDARUMA & MASINGA POWER STATIONS

Date: 24th May, 2019

CLARIFICATION No. 2

In accordance with the “Tender for Supply Intake and Spill gate Seals for Kamburu, Kindaruma & Masinga Power Stations”, KenGen hereby issues **Clarification No. 2**

ADDITIONAL INFORMATION

ITEM NO.	PRICE SCHEDULE ITEM NO.	CLARIFICATION	DRAWING
1	Item 1	Supply 6 pieces each of left and right side corner seals (mirror reflection)	 <p>A 3D perspective drawing of a corner seal. The dimensions are: top length 170, top thickness 30, top offset 60, top offset 50, height 88, bottom length 160, bottom width 100, bottom thickness 40, and a 20mm diameter hole. A label '20mm Φ hole' points to the hole.</p>
2	Item 2	Length of seal given on the drawing should be 14000mm and not 1400mm as earlier given.	 <p>A 3D perspective drawing of a long seal. The dimensions are: width 100, height 40, and length 14000. A label '20mm Φ hole' points to the hole.</p>

3	Item 3	Two dimensions had been left out on the initial drawing. This has now been included and in red as per attached revised drawing.	<p>The drawing shows a mechanical part with the following specifications:</p> <ul style="list-style-type: none"> Overall length: 220 Overall width: 115 Overall height: 35 Top surface features: <ul style="list-style-type: none"> Two $\phi 21\text{mm}$ holes, each 27mm deep. Two $\phi 40\text{mm}$ holes. Two $\phi 16\text{mm}$ holes. Dimensions in red (revisions): <ul style="list-style-type: none"> 110 (width of a top section) 70 (width of a sloped section) Other dimensions: 25, 40, 60, 115, 180, 10, 40, 10, 60, 57.
---	--------	---	---

Note:- Tenderers must quote for the specified Neoprene rubber or equivalent or better grade rubber. Where different rubber is to be provided (other than Neoprene), technical data **must be provided**.

ACKNOWLEDGEMENT OF CLARIFICATION No.2

We, the undersigned hereby certify that the clarification is an integral part of the document and the alterations set out in the clarification have been incorporated in the tender proposal.

Signed.....

Tenderer.....

Date.....